



PHASE A

PHASE B

PHASE C

BEAVER ELECTRICAL MACHINERY LTD.
BURNABY, BRITISH COLUMBIA, CANADA

MODEL: GIP--
VOLTS: ---
FUSE (I.R.): 0.5A (200kA)
PH: 3
HZ: 60
ENCLOSURE: TYPE 1
JOB NO: -----
DATE: ----- cULus LISTED


GROUND FAULT INDICATOR

NORMAL OPERATION: ALL LIGHTS EQUALLY BRIGHT
FAULT CONDITION: LIGHT OUT ON GROUNDED PHASE
CALL AN ELECTRICIAN

INDICATEUR DE DÉFAUT À LA TERRE

FONCTIONNEMENT NORMAL : TOUTES LES LUMIÈRES SONT ÉGALEMENT LUMINEUSES
CONDITION DE DÉFAUT : LUMIÈRE ÉTEINTE SUR PHASE À LA TERRE
APPELÉZ UN ÉLECTRICIEN

INSTALLER'S
CONNECTION

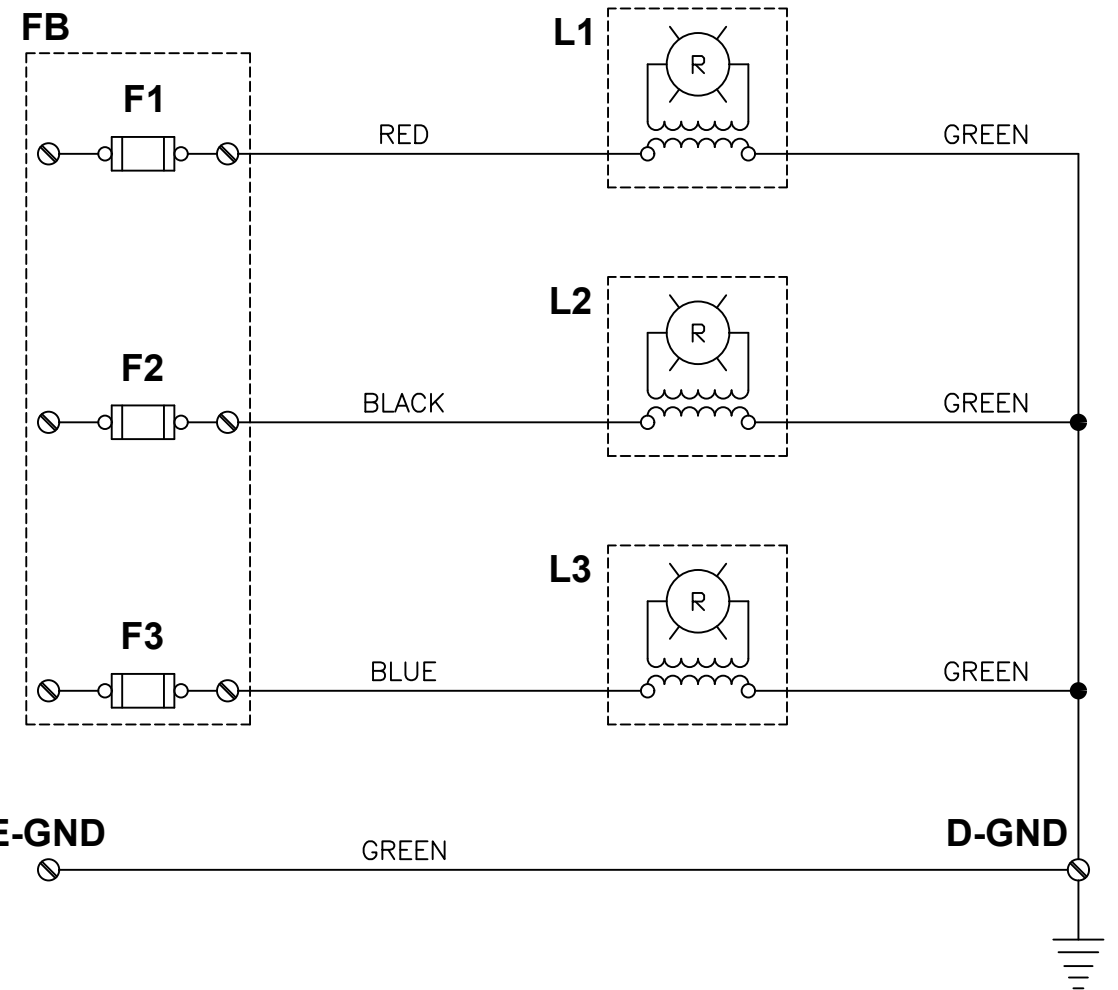

BILL OF MATERIAL

L1-L3	3	transformer indicating light (200/220V)	DR22DOL-M4R(200/220V)	FUJI
L1-L3	3	transformer indicating light (480V)	DR22DOL-V4R(480V)	FUJI
L1-L3	3	transformer indicating light (600V)	DR22DOL-W4R(600V)	FUJI
FB	1	class CC fuse block - 3P, 600V, 30A	FB01G3PL	LITTELFUSE
F1-3	3	class CCfast acting fuse - 0.5A, 600V AC, IR 200kA	KLKR 0.5	LITTELFUSE
D-GND	1	door ground stud - $\frac{10}{32} \times \frac{1}{2}$	n/a	BEL
E-GND	2	enclosure ground stud - $\frac{10}{32} \times \frac{1}{2}$	n/a	BEL
ENCL	1	enclosure - NEMA Type 4/12	RS - 09 x 6.5 x 04	BEL
ITEM	QTY.	DESCRIPTION	PART NO.	MFG.



BEAVER ELECTRICALMACHINERY LIMITED
BURNABY,BC,V5J 5A4
PHONE: (604) 431-5000, TOLL FREE 1-800-663-6505
beaverelectrical.com

This drawing is the
exclusive property of
Beaver Electrical
Machinery Ltd. and all
rights are reserved.
No part of this drawing
may be used or
reproduced in any form
whatsoever without
written permission from
Beaver Electrical.

CUSTOMER:
BEAVER ELECTRICAL MACHINERY
BURNABY, B.C.

TITLE:
GROUND INDICATING PANEL
208-600V AC, 3PH, 3W

DRAW. DESCRIPTION:
ELECTRICAL CIRCUIT
& BILL OF MATERIAL

DSN. BY:
M.H.

DRN. BY:
D.S.

APP. BY:
M.H.

PAGE:
1 OF 1

SCALE:
NTS

DATE

REV.

DESCRIPTION

FEB ,2025

0

ORIGINAL

ENG. PERMIT#:1002813

DRAWING NO:

GIP PANEL